


## SEM1630 USER GUIDE

DIN RAIL MOUNTED TRIP AMP  
 UNIVERSAL INPUT  
 DUAL Form C OUTPUT

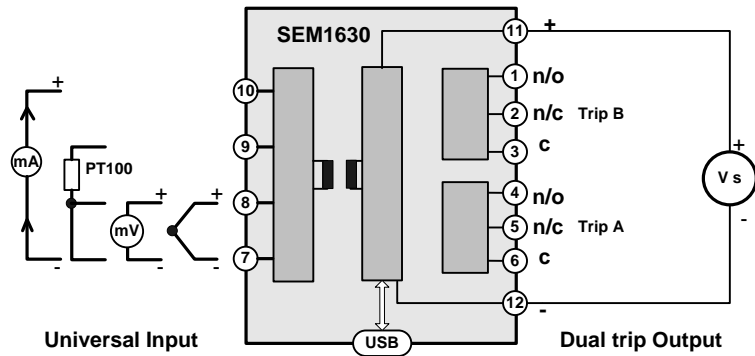

**Important – Potentially Hazardous situations. Persons responsible for the installation and operation of this equipment must be fully aware of all aspects of this guide. Failure to follow the instructions can cause severe injuries and damage.**

Every effort has been taken to ensure the accuracy of this document, however we do not accept responsibility for damage, injury, loss or expense resulting from errors and omissions, and we reserve the right of amendment without notice.



### IMPORTANT - CE & SAFETY REQUIREMENTS

This product is classed as “PERMANENTLY CONNECTED EQUIPMENT”.

Product must be DIN rail mounted, inside a suitable enclosure providing environmental protection to IP65 or greater.

DC supply must be derived from a local supply and not a distribution system.

Max. relay contact rating 250VAC @ 1A (30VDC @ 1A). Any circuit connected to a contact must be fused with a 2A (T) fuse.

To maintain CE EMC requirements, input wires must be less than 30 meters.

The product contains no serviceable parts, or internal adjustments. no attempt must be made to repair this product. Faulty units must be returned to supplier for repair.

This product must be installed by a qualified person. All electrical wiring must be carried out in accordance with the appropriate regulations for the place of installation.

Before attempting any electrical connection work, please ensure all supplies are switched off.

ABSOLUTE MAXIMUM OPERATING CONDITIONS (To exceed may cause damage to the unit):-

Supply Voltage	± 30 VDC (Protected for over voltage and reverse connection)
Current with over voltage	± 200 mA
Input Voltage	± 5 V between any terminals
Input Current	± 100 mA between terminals 7 & 10
Ambient	Temperature (-30 to 75) °C Humidity (10 to 95) % RH (Non condensing)

### PRODUCT SPECIFICATION

Please refer to the product data sheet for full specification, available to download at [www.statinst.com](http://www.statinst.com).


### RECEIVE AND UNPACKING

Please inspect the packaging and instrument thoroughly for any signs of transit damage. If the instrument has been damaged, please notify your supplier immediately.

### CONFIGURATION




**IMPORTANT** - The SEM1630 can be configured while connected and powered, but a portable battery powered computer must be used to avoid the effects of ground loops.

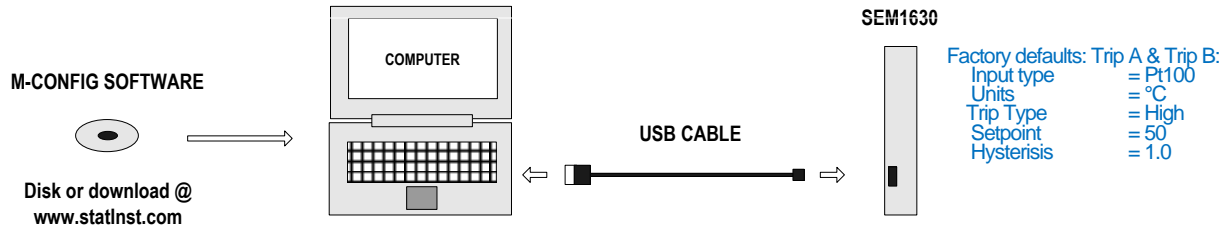


The conditioner may be purchased pre-configured, if specified at the time of order. The user can re-configure the conditioner by connecting it to the USB port of a PC using a standard USB to mini 5 pin USB cable and running the Status Instruments USB\_CONFIG software, available free from [www.statinst.com](http://www.statinst.com). The USB port supplies power to the SEM1630 during configuration, no additional wiring is required. The following parameter can be configured by simply entering as prompted by the software package.

- Input type (K,J,E,N,T,R,S,mV,Pt100,mA)
- Setpoint Trip A & B
- Hysteresis Trip A & B
- Units (°C, °F, mV, mA)
- Trip A & B Level (High or Low)

## MECHANICAL INSTALLATION

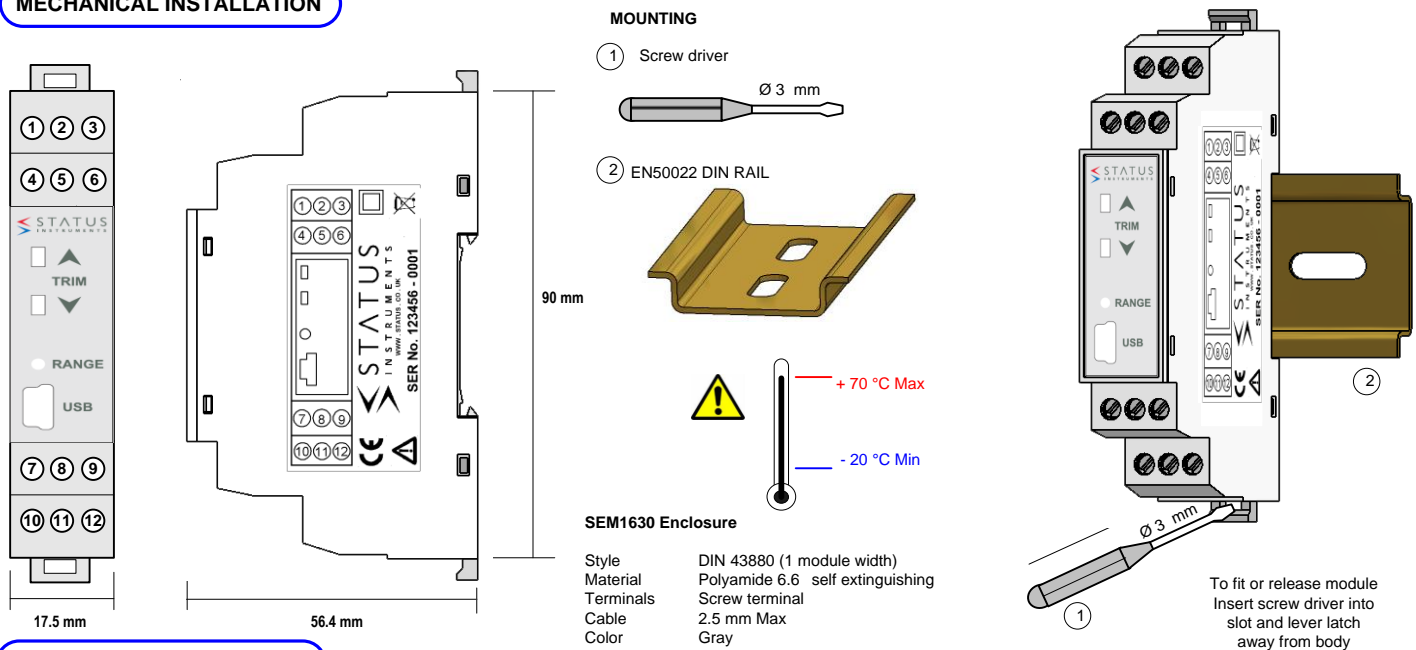

## ELECTRICAL INSTALLATION

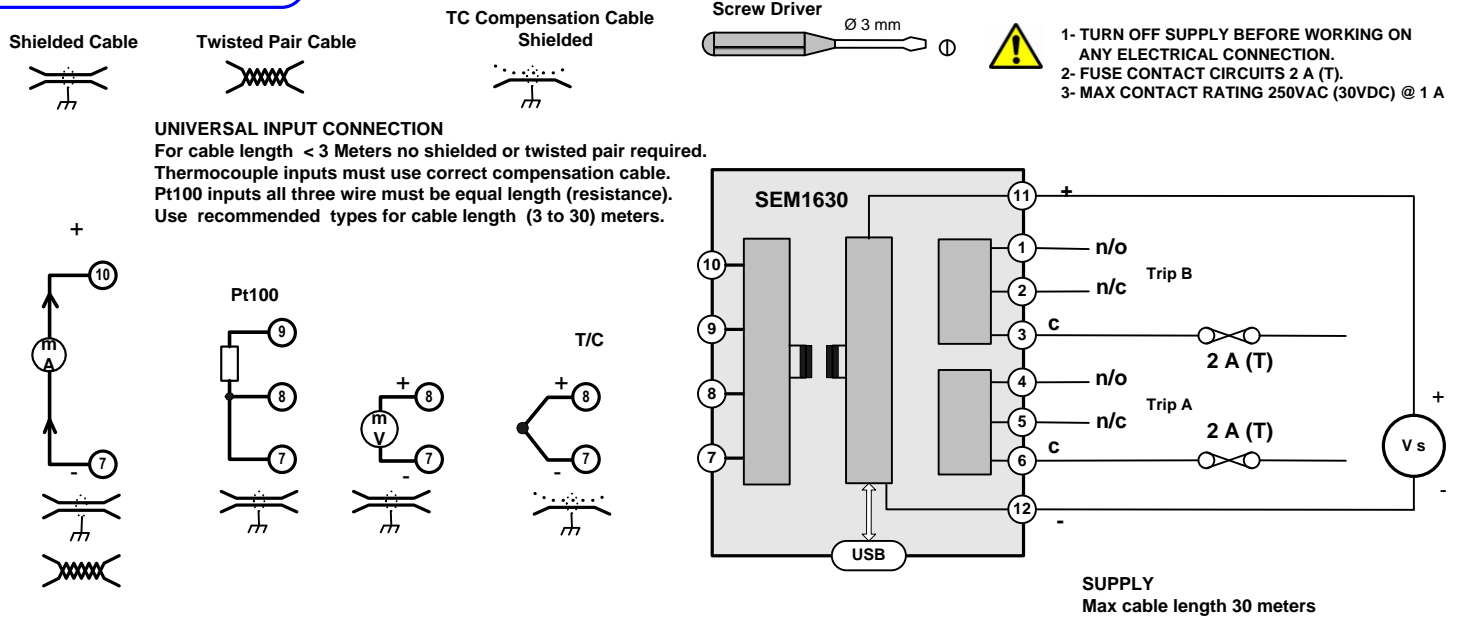

## FRONT PANEL INDICATION

Trip A alarm LED on in alarm state

Trip B alarm LED on in alarm state

Range LED on when input is out of range

USB configuration port

